



Setting leak alerts eyeonwater

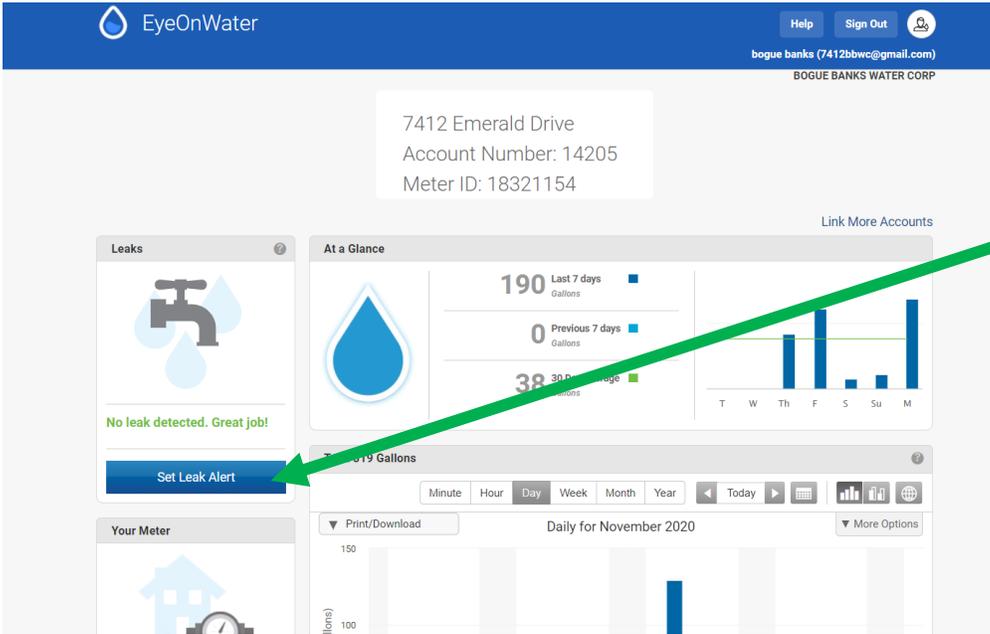


Login to eyeonwater account

Click on set leak alert on the top left of screen

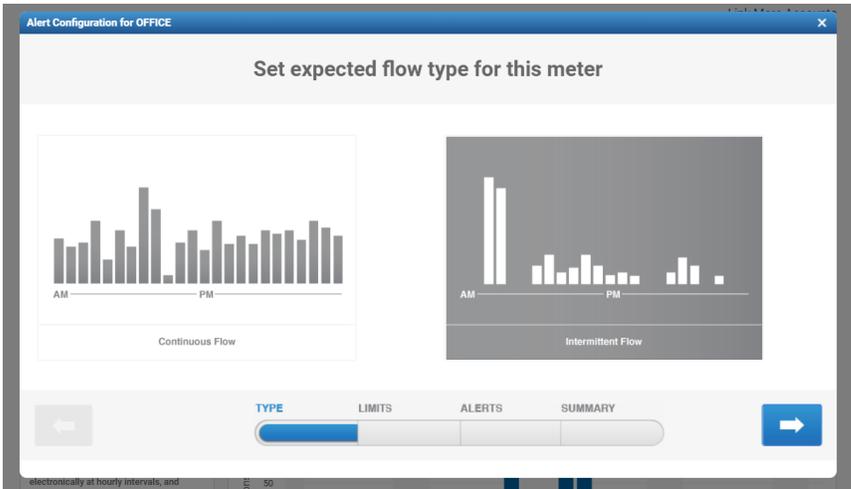

Select intermittent flow unless continuous flow is expected


Click the blue arrow to go to the next screen

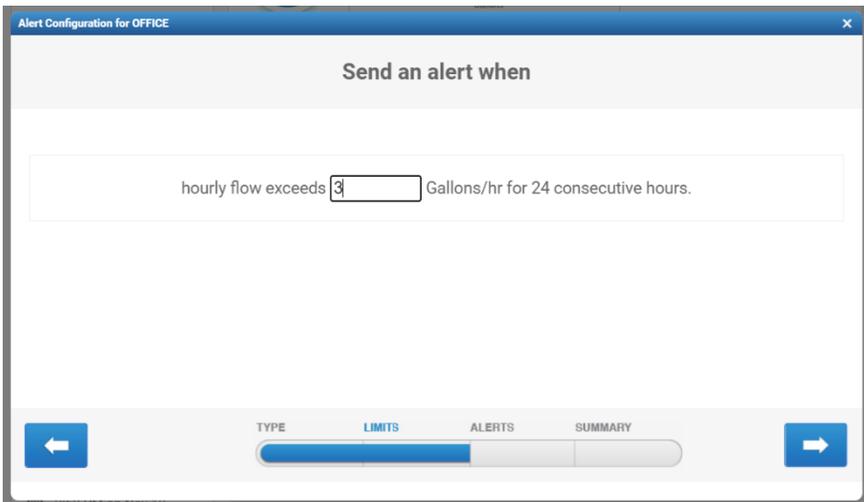

For permanent residents set between 1-3 gallons

If this is a vacation property should set to 1 gallon

Click the blue arrow to continue to next page

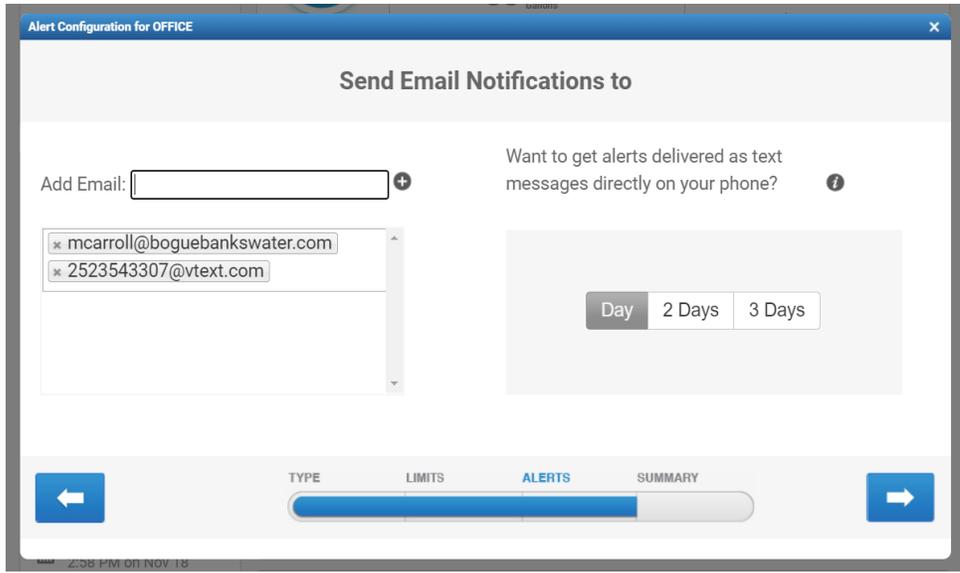

Here you can set up to send email notifications and/or text notifications

You can add as many email or phone numbers – also you can remove them from this screen

Mobile carrier	SMS gateway domain
Alltel ^[8]	sms.alltelwireless.com
AT&T ^[9]	txt.att.net
Boost Mobile ^[8]	sms.myboostmobile.com
Cricket Wireless	mms.cricketwireless.net
FirstNet ^[8]	txt.att.net
Google Fi ^[10]	
MetroPCS	mymetropcs.com
Republic Wireless ^[11]	text.republicwireless.com
Sprint ^[8]	messaging.sprintpcs.com
T-Mobile ^[8]	tmomail.net
U.S. Cellular ^[8]	email.uscc.net
Verizon Wireless ^[12]	vtext.com
Virgin Mobile ^[8]	vmobl.com

Depending on your wireless carrier you will input phone number followed by @ and the SMS Gateway domain

Alert Configuration for OFFICE

Preview alert

Alert Settings		Notifications ⓘ
Type of flow	Intermittent	<p>Start Reminder Stop</p> <p>Leak start alert In the past 24 hours, a leak of XXX /hr has been detected.</p>
Flow Threshold	Maximum 3 Gallons /hr	
Reminder Frequency	Every day	
Alert Status	<input checked="" type="checkbox"/> Active <input type="checkbox"/>	
Test Alert	<input type="checkbox"/> Inactive <input checked="" type="checkbox"/>	

← TYPE LIMITS ALERTS SUMMARY Save

Here you can select to set Alert status to **ACTIVE** and Test Alert to **ACTIVE** and then click save

You should receive an email and/or text for test notification soon after